



商用廚房瓶裝石油氣裝置

「快速檢查」結果分享

機電工程署

氣體標準事務處

2022年12月9日



2017年石油氣事故

主因：

- 石油氣金屬喉管嚴重銹蝕
- 沒有做定期安全檢查
- 收工後沒有關閉供氣總掣



石油氣漏通宵 茶餐廳大爆炸

清晨開工搗爐 廚工食客命危 街道淪廢墟

香港文匯報訊（記者 杜法祖）土瓜灣發生罕見石油氣大爆炸，前日剛更換石油氣罐並檢查過爐具的一間茶餐廳，懷疑因有石油氣通宵洩漏積聚，至昨清晨開門營業，廚工兩種爐即引發大爆炸，整間食肆被炸至滿目瘡痍全變廢墟，舖內雜物隨爆炸強勁氣流噴出店外，殃及街外汽車、咪錶及附近店舖招牌及鐵閘，意外中一名廚工及一名食客當場重傷命危，另一食客及老闆娘亦分別輕傷及受驚。消防聯同機電署正調查事故肇因。



茶餐廳雜物炸飛街外，殃及汽車及其他店舖可滿目瘡痍。



九成半皮膚燒傷的廚工送院後命危。



受驚茶餐廳老闆娘被送院。




全港食肆問卷調查 及 商用廚房 瓶裝石油氣裝置「快速檢查」 結果概要



全港食肆問卷調查結果概要



食肆主要煮食能源分類

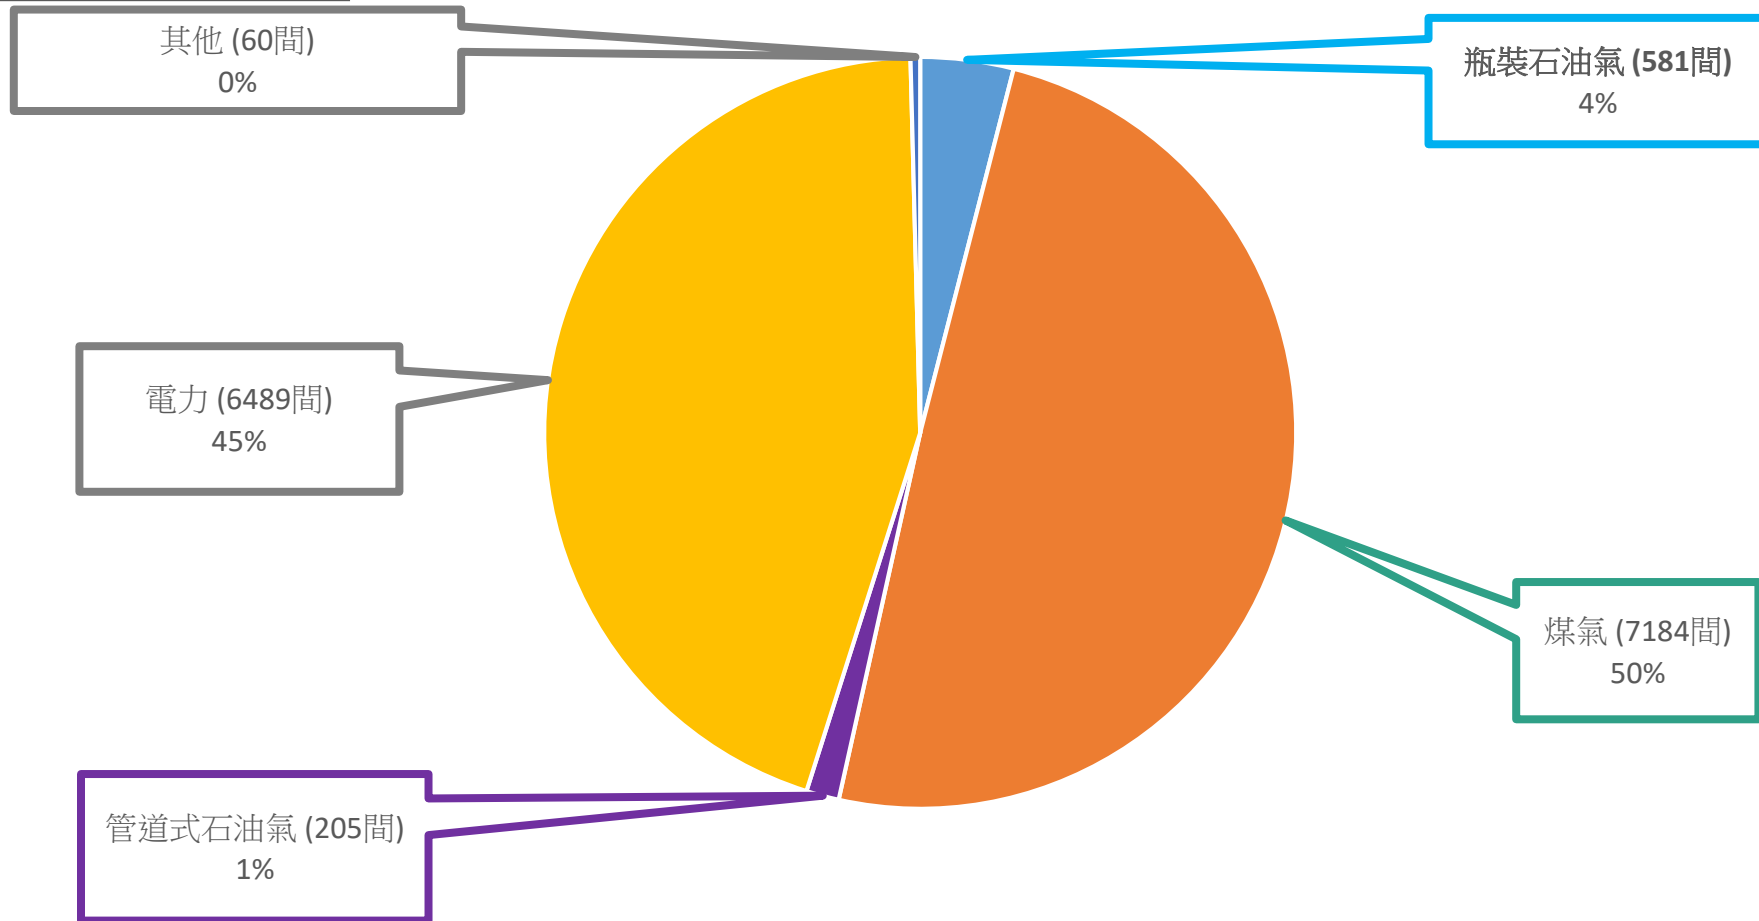


商用廚房瓶裝石油氣裝置「快速檢查」總結



使用瓶裝石油氣食肆數量:	581 (到訪調查食肆的 4.0%)
篩選條件:	<ol style="list-style-type: none">1. 使用瓶裝石油氣2. 氣體裝置安裝超過 6 年3. 使用氣體硬喉供氣
被選中進行「快速檢查」的食肆數量:	339 (使用瓶裝石油氣食肆的 58.3%)
「快速檢查」完成數量:	339 (被選中進行「快速檢查」食肆的 100%)
需作改善的食肆數量:	96 (「快速檢查」完成的 28.3%)
已完成改善工程的食肆數量:	81 (需作改善食肆的 84.4%)

商用廚房瓶裝石油氣裝置「快速檢查」總結

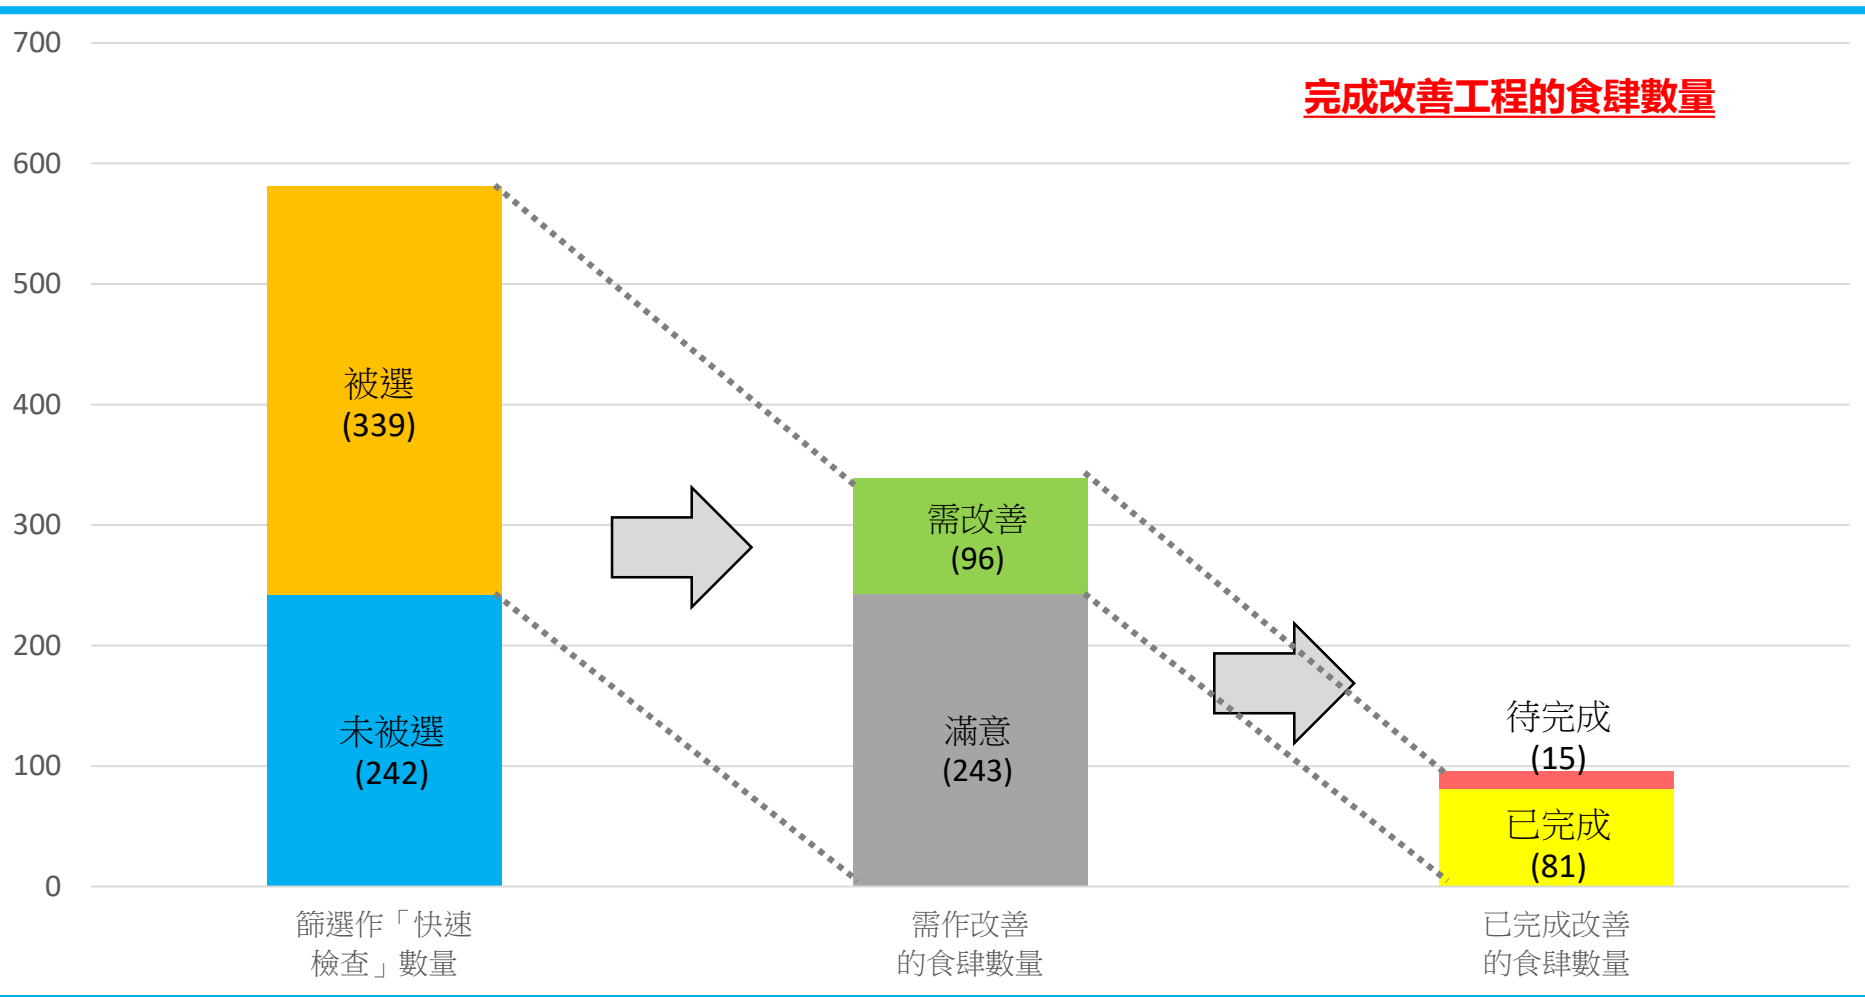

商用廚房氣體裝置「快速檢查」



商用廚房氣體裝置「快速檢查」紀錄表 (石油氣瓶供氣)

Commercial Kitchen Gas Installation "Quick Check" Record Form (LPG Cylinder Supply)

客戶名稱 Name of customer: _____

地址 Address: _____

檢查日期 Date of checking: _____

E 部份 – 改善建議 Part E – Recommended Improvement

- 建議更換 部份/全部* 喉管。
Recommend replacing section(s)/all* of the gas pipes.
- 建議更換 軟線* 及 調壓器*。
Recommend replacing the flexible tubing* and regulators*.
- 建議 更換/維修* 以下氣體用具。

註：以上「快速檢查」旨在針對處所內氣體裝置及附屬設施的基本運作和外露氣體喉管狀況進行初步檢測。食物業處所的負責人應每 12 個月安排註冊氣體工程承辦商，為其氣體裝置及爐具進行一次更全面的定期安全檢查及維修保養，以確保氣體安全。

石油氣瓶調節器狀況 Condition of cylinder regulators (使用限期 Expiry date: _____)			
接駁軟線狀況 Condition of flexible tubing (使用限期 Expiry date: _____)			
B 部份 – 檢漏測試 Part B – Leak Tests			
外露喉管接駁位和配件氣泡探漏測試 Bubble leak test for exposed pipe joints and fittings			
使用燃氣探測器為氣體裝置檢漏 Leak tests for gas installations using a gas detector			
(上述測試顯示在 _____ 千帕的供氣壓力下未有洩漏) (Leakage was not found at a supply pressure of _____ kPa in the above tests)			
C 部份 – 功能測試 Part C – Functional Tests			
氣體用具運作狀況 Operation of gas appliances			
熄火保險裝置運作狀況 Operation of flame failure devices			
消防安全閥和截氣閥運作狀況 Operation of fire safety and isolation valves			
機動排氣系統運作狀況(開/關) Operation of mechanical ventilation system (On/Off)			
機動排氣系統聯鎖裝置運作狀況 Operation of mechanical ventilation system interlock			
D 部份 – 氣體用具資料 Part D – Gas Appliance Information			
此廚房共有氣體用具 _____ 件，當中包括：There are _____ units of gas appliances in this kitchen, including:			
___ x 平面/底爐 Boiling Table/ Stockpot	___ x 中式炒爐 Chinese Wok Range		
___ x 家用座焗爐 Domestic Hotplate	___ x 扒爐 Griddle Range		
___ x 中壓高壓爐 Medium Pressure Oven	___ x 焗爐 Oven		
___ x 焗豬/烤鴨爐 Pig / Duck Roaster	___ x 飯煲 Rice Cooker		
___ x 蒸櫃/爐 Steamer	___ x 熱水爐 Water Heater		
___ x 其他 Other (請註明 Please specify)			

* 刪去不適用者 Delete as appropriate

Rev. 8/2019

此紀錄將呈交予氣體安全監督作紀錄用途
This record will be submitted to the Gas Authority for recording purpose

- 應確保儲存於店舖內的石油氣瓶(包括空瓶)總容水量時刻不超過法例規限的 130 公升(約 50 公斤)。
Ensure the total nominal water capacity of LPG cylinders (including empty cylinders) in shop is always kept below the statutory limit of 130 litres (about 50kg).
- 其他 Other: _____
- 檢查後發出危險氣體裝置通告 (編號: _____)
A Dangerous Gas Installation (DGI) Notice was issued after checking (No. _____)

客戶簽署 Customer's Signature: _____

註冊氣體裝置技工簽署

Registered Gas Installer's Signature: _____

(註冊氣體裝置技工姓名 RGI Name: _____)

(註冊氣體裝置技工編號 RGI No. _____)

註冊氣體工程承辦商名稱及編號 Registered Gas Contractor Company Name and Registration No.:

RGC Registration No.: (_____ - _____)

印章及簽署 Company Chop and Signature: _____

本紀錄簽發日期 Issue Date of this record: _____

註：以上「快速檢查」旨在針對處所內氣體裝置及附屬設施的基本運作和外露氣體喉管狀況進行初步檢測。食物業處所的負責人應每 12 個月安排註冊氣體工程承辦商，為其氣體裝置及爐具進行一次更全面的定期安全檢查及維修保養，以確保氣體安全。

Note: The above "Quick Check" aims at providing a preliminary examination on the basic operation of the gas installations and the associated facilities and the condition of the exposed gas pipework in the concerned premise. To ensure gas safety, the responsible persons of licensed food premises should arrange a registered gas contractor to carry out a more comprehensive RGI repair and maintenance of their gas installations and appliances once every 12 months.

* 刪去不適用者 Delete as appropriate

Rev. 8/2019

此紀錄將呈交予氣體安全監督作紀錄用途
This record will be submitted to the Gas Authority for recording purpose

「快速檢查」記錄分享 (1/4)



商用廚房氣體裝置「快速檢查」記錄表 (石油氣瓶供氣)
Commercial Kitchen Gas Installation "Quick Check" Record Form (LPG Cylinder Supply)

客戶名稱 Name of customer: _____

地址 Address: _____

檢查日期 Date of checking: _____

A 部份 – 目測檢查 Part A – Visual Inspection	滿意 Satisfactory	需要改善 Improvement needed	不適用 N/A
石油氣瓶儲存室的完整性 Integrity of LPG cylinder storage chamber	✓		
外露硬喉管狀況 (是否有嚴重蝕蝕和損傷) Condition of exposed rigid pipework (any serious corrosion or damages)	✓		
石油氣瓶調節器狀況 Condition of cylinder regulators (使用限期 Expiry date: <u>N/A</u>)	✓		
接駁軟喉管狀況 Condition of flexible tubing (使用限期 Expiry date: <u>2023</u>)	✓		
B 部份 – 檢漏測試 Part B – Leak Tests			
外露喉管接駁位和配件氣泡探漏測試 Bubble leak tests for exposed pipe joints and fittings	✓		
使用燃氣探測器為氣體裝置檢漏 Leak tests for gas installations using a gas detector	✓		
(上述測試顯示在 <u>4.4</u> 千帕的供氣壓力下未有洩漏) (Leakage was not found at a supply pressure of <u>4.4</u> kPa in the above tests)	✓		
C 部份 – 功能測試 Part C – Functional Tests			
氣體用具運作狀況 Operation of gas appliances	✓		
熄火保險裝置運作狀況 Operation of flame failure devices	✓		
消防安全閥和截氣閥運作狀況 Operation of fire safety and isolation valves	✓		
機動排氣系統運作狀況(開/關) Operation of mechanical ventilation system (On/Off)	✓		
機動排氣系統聯鎖裝置運作狀況 Operation of mechanical ventilation system interlock			✓
D 部份 – 氣體用具資料 Part D – Gas Appliance Information			
此廚房共有氣體用具 _____ 件，當中包括：There are _____ units of gas appliances in this kitchen, including:			
— x 平面/底爐 Boiling Table/ Stockpot	— x 中式炒爐 Chinese Wok Range		
— x 家用座檯爐 Domestic Hotplate	— x 扒爐 Griddle Range		
— x 中壓高壓爐 Medium Pressure Stove	— x 焗爐 Oven		
— x 豬籠/烤鴨爐 Pig / Duck Roaster	— x 飯煲 Rice Cooker		
— x 蒸籠/燉 Steamer	— x 熱水爐 Water Heater		
3 x 其他 (請註明 Please specify) <u>底壓口噴咀</u>			

* 刪去不適用者 Delete as appropriate

此記錄將提交予氣體安全監督作記錄用途
This record will be submitted to the Gas Authority for recording purpose

Rev. 8/2019

E 部份 – 改善建議 Part E – Recommended Improvement

建議更換 部份/全部* 喉管。
Recommend replacing section(s)/all* of the gas pipes.

建議更換 軟喉* 及 調壓器*。
Recommend replacing the flexible tubing* and regulators*.

建議 更換/維修* 以下氣體用具。
Recommend repairing/replacing* the following gas appliances:

建議安排一次全面的定期安全檢查，以作深入檢測。
Recommend arranging a comprehensive Regular Safety Inspection (RSI) for further examination.

建議在營業時間結束時關上主供氣掣，並於醒目位置展示相關的警告告示。
Recommend turning off the main gas supply valve before the close of business and displaying the related warning notices at prominent positions.

確保儲存於店舖內的石油氣瓶(包括空瓶)總容水量時刻不超過法例規限的 130 公升(約 50 公斤)。
Ensure the total nominal water capacity of LPG cylinders (including empty cylinders) in shop is always kept below the statutory limit of 130 litres (about 50kg).

其他 Other: _____

檢查後發出危險氣體裝置通告 (編號: _____)
A Dangerous Gas Installation (DGI) Notice is issued after checking (No. _____)

註：以上「快速檢查」旨在針對處所內氣體裝置及附屬設施的基本運作和外露氣體喉管狀況進行初步檢測，食物業處所的負責人應每 12 個月安排註冊氣體工程師，為其氣體裝置及爐具進行一次更全面的定期安全檢查及維修保養，以確保氣體安全。

Note: The above "Quick Check" aims at providing a preliminary examination on the basic operation of the gas installations and the associated facilities and the condition of the exposed gas pipework in the concerned premise. To ensure gas safety, the responsible persons of licensed food premises should arrange a registered gas contractor to carry out a more comprehensive RSI, repair and maintenance of their gas installations and appliances once every 12 months.

* 刪去不適用者 Delete as appropriate

此記錄將提交予氣體安全監督作記錄用途
This record will be submitted to the Gas Authority for recording purpose

Rev. 8/2019

「快速檢查」記錄分享 (2/4)




商用廚房氣體裝置「快速檢查」紀錄表 (石油氣瓶供氣)
Commercial Kitchen Gas Installation "Quick Check" Record Form (LPG Cylinder Supply)

客戶名稱 Name of customer:

地址 Address:

檢查日期 Date of checking:

A 部份 - 目測檢查 Part A - Visual Inspection	滿意 Satisfactory	需要改善 Improvement needed	不適用 N/A
石油氣瓶儲存室的完整性 Integrity of LPG cylinder storage chamber			✓
外露硬喉管狀況 (是否有嚴重鏽蝕和損傷) Condition of exposed rigid pipework (any serious corrosion or damages)			✓
石油氣瓶調節器狀況 Condition of cylinder regulators (使用限期 Expiry date: <u>n/a</u>)	✓		
接駁軟喉狀況 Condition of flexible tubing (使用限期 Expiry date: <u>低壓: 8/2024, 中壓: 5/2023</u>)	✓	✓	
B 部份 - 檢漏測試 Part B - Leak Tests			
外露喉管接駁位和配件氣泡探漏測試 Bubble leak tests for exposed pipe joints and fittings	✓		
使用燃氣探測器為氣體裝置檢漏 Leak tests for gas installations using a gas detector (上述測試顯示在 <u>4.4</u> 千帕的供氣壓力下未有洩漏) (Leakage was not found at a supply pressure of <u>4.4</u> kPa in the above tests)	✓		
C 部份 - 功能測試 Part C - Functional Tests			
氣體用具運作狀況 Operation of gas appliances	✓		
熄火保險裝置運作狀況 Operation of flame failure devices	✓		
消防安全閥和截氣閥運作狀況 Operation of fire safety and isolation valves			✓
機動排氣系統運作狀況(開/關) Operation of mechanical ventilation system (On/Off)	✓		
機動排氣系統聯鎖裝置運作狀況 Operation of mechanical ventilation system interlock			✓
D 部份 - 氣體用具資料 Part D - Gas Appliance Information			
此廚房共有氣體用具 <u>2</u> 件, 當中包括: There are <u>2</u> units of gas appliances in this kitchen, including:			
<input checked="" type="checkbox"/> x 平面/底爐 Boiling Table/ Stockpot	<input type="checkbox"/> x 中式炒爐 Chinese Wok Range		
<input type="checkbox"/> x 家用座枱爐 Domestic Hotplate	<input type="checkbox"/> x 扒爐 Griddle Range		
<input checked="" type="checkbox"/> x 中壓高壓爐 Medium Pressure Stove	<input type="checkbox"/> x 焗爐 Oven		
<input type="checkbox"/> x 燒豬/烤鴨爐 Pig / Duck Roaster	<input type="checkbox"/> x 飯煲 Rice Cooker		
<input type="checkbox"/> x 蒸櫃/爐 Steamer	<input type="checkbox"/> x 熱水爐 Water Heater		
<input type="checkbox"/> x 其他 Other (請註明 Please specify)			



E 部份 - 改善建議 Part E - Recommended Improvement

建議更換 部份/全部* 喉管。
Recommend replacing section(s)/all* of the gas pipes.

建議更換 軟喉* 及 調節器*。
Recommend replacing the flexible tubing* and regulators*.

建議 更換/維修* 以下氣體用具。
Recommend repairing/replacing* the following gas appliances:

建議安排一次全面的定期安全檢查, 以作深入檢測。
Recommend arranging a comprehensive Regular Safety Inspection (RSI) for further examination.

建議在營業時間結束時關上主供氣掣, 並於當眼位置展示相關的警告告示。
Recommend turning off the main gas supply valve before the close of business and displaying the related warning notices at prominent positions.

應確保儲存於店舖內的石油氣瓶(包括空瓶)總容量時刻不超過法例規限的 130 公升(約 50 公斤)。
Ensure the total nominal water capacity of LPG cylinders (including empty cylinders) in shop is always kept below the statutory limit of 130 litres (about 50kg).

其他 Other:

檢查後發出危險氣體裝置通告 (編號: _____)
A Dangerous Gas Installation (DGI) Notice was issued after checking (No. _____)

* 刪去不適用者 Delete as appropriate

Rev. 8/2019

此紀錄將呈交予氣體安全監督作記錄用途
This record will be submitted to the Gas Authority for recording purpose

* 刪去不適用者 Delete as appropriate

Rev. 8/2019

此紀錄將呈交予氣體安全監督作記錄用途
This record will be submitted to the Gas Authority for recording purpose

註: 以上「快速檢查」旨在針對處所內氣體裝置及相關設施的基本運作和外露氣體喉管狀況進行初步檢測。食物業處所的負責人應每 12 個月安排註冊氣體工程承辦商, 為其氣體裝置及爐具進行一次更全面的定期安全檢查及維修保養, 以確保氣體安全。

Note: The above "Quick Check" aims at providing a preliminary examination on the basic operation of the gas installations and the associated facilities and the condition of the exposed gas pipework in the concerned premise. To ensure gas safety, the responsible persons of licensed food premises should arrange a registered gas contractor to carry out a more comprehensive RSI, repair and maintenance of their gas installations and appliances once every 12 months.

「快速檢查」記錄分享 (3/4)



商用廚房氣體裝置「快速檢查」紀錄表 (石油氣瓶供氣)
Commercial Kitchen Gas Installation "Quick Check" Record Form (LPG Cylinder Supply)

客戶名稱 Name of customer: _____

地址 Address: _____

檢查日期 Date of checking: _____

A 部份 - 目測檢查 Part A - Visual Inspection	滿意 Satisfactory	需要改善 Improvement needed	不適用 N/A
石油氣瓶儲存室的完整性 Integrity of LPG cylinder storage chamber <u>石油氣瓶存室門裝埋</u>		✓	
外露硬喉管狀況 (是否有嚴重鏽蝕及損傷) Condition of exposed rigid pipework (any serious corrosion or damages) <u>石油氣喉管需加裝油尾加裝LPG喉管</u>		✓	
石油氣瓶調壓器狀況 Condition of cylinder regulators (使用限期 Expiry date: _____) <u>CAS 交接紀錄</u>	✓		
接駁軟喉狀況 Condition of flexible tubing (使用限期 Expiry date: <u>17/8/2015</u>) <u>豬尾喉共4架</u>		✓	
B 部份 - 檢漏測試 Part B - Leak Tests			
外露喉管接駁位和配件氣泡探漏測試 Bubble leak tests for exposed pipe joints and fittings	✓		
使用燃氣探測器為氣體裝置檢漏 Leak tests for gas installations using a gas detector	✓		
(上述測試顯示在 <u>4.5</u> 千帕的供氣壓力下未有洩漏) (Leakage was not found at a supply pressure of <u>4.5</u> kPa in the above tests)			
C 部份 - 功能測試 Part C - Functional Tests			
氣體用具運作狀況 Operation of gas appliances	✓		
熄火保險裝置運作狀況 Operation of flame failure devices	✓		
消防安全閥和截氣閥運作狀況 Operation of fire safety and isolation valves <u>消防安全閥被阻擋, 制氣波片及流量要改善</u>		✓	
機動排氣系統運作狀況(開/關) Operation of mechanical ventilation system (On/Off)	✓		
機動排氣系統聯鎖裝置運作狀況 Operation of mechanical ventilation system interlock <u>未有機動排氣系統聯鎖裝置</u>		✓	
D 部份 - 氣體用具資料 Part D - Gas Appliance Information			
此廚房共有氣體用具 <u>1</u> 件, 當中包括: There are _____ units of gas appliances in this kitchen, including:			
<input checked="" type="checkbox"/> x 平面/底爐 Boiling Table/ Stockpot	<input type="checkbox"/> x 中式炒爐 Chinese Wok Range		
<input type="checkbox"/> x 家用座檯爐 Domestic Hotplate	<input type="checkbox"/> x 扒爐 Griddle Range		
<input type="checkbox"/> x 中壓高壓爐 Medium Pressure Stove	<input type="checkbox"/> x 焗爐 Oven		
<input type="checkbox"/> x 燒豬/烤鴨爐 Pig / Duck Roaster	<input type="checkbox"/> x 飯煲 Rice Cooker		
<input type="checkbox"/> x 蒸籠/爐 Steamer	<input type="checkbox"/> x 熱水爐 Water Heater		
<input type="checkbox"/> x 其他 Other (請註明 Please specify)			

* 刪去不適用者 Delete as appropriate

Rev. 8/2019

此紀錄將呈交予氣體安全監督作記錄用途
This record will be submitted to the Gas Authority for recording purpose

E 部份 - 改善建議 Part E - Recommended Improvement

建議更換 部份/全部* 喉管。

Recommend replacing section(s)/all* of the gas pipes.

建議更換 軟喉* 及 調壓器*。

Recommend replacing the flexible tubing* and regulators*.

建議 更換/維修* 以下氣體用具。

Recommend repairing/replacing* the following gas appliances:

建議安排一次全面的定期安全檢查, 以作深入檢測。

Recommend arranging a comprehensive Regular Safety Inspection (RSI) for further examination.

建議在營業時間結束時關上主供氣擊, 並於當眼位置展示相關的警告告示。

Recommend turning off the main gas supply valve before the close of business and displaying the related warning notices at prominent positions.

應確保儲存於店舖內的石油氣瓶(包括空瓶)總容水量時刻不超過法例規限的 130 公升(約 50 公斤)。

Ensure the total nominal water capacity of LPG cylinders (including empty cylinders) in shop is always kept below the statutory limit of 130 litres (about 50kg).

其他 Other:

檢查後發出危險氣體裝置通告 (編號: _____)

A Dangerous Gas Installation (DGI) Notice was issued after checking (No. _____)

客戶簽署 Customer's Signature: _____

註冊氣體裝置技工簽署
Registered Gas Fitter's Signature: _____

註: 以上「快速檢查」旨在針對處所內氣體裝置及附屬設施的基本運作和外露氣體喉管狀況進行初步檢測。食物業處所的負責人應每 12 個月安排註冊氣體工程承辦商, 為其氣體裝置及爐具進行一次更全面的定期安全檢查及維修保養, 以確保氣體安全。

Note: The above "Quick Check" aims at providing a preliminary examination on the basic operation of the gas installations and the associated facilities and the condition of the exposed gas pipework in the concerned premise. To ensure gas safety, the responsible persons of licensed food premises should arrange a registered gas contractor to carry out a more comprehensive RSI, repair and maintenance of their gas installations and appliances once every 12 months.

* 刪去不適用者 Delete as appropriate

Rev. 8/2019

此紀錄將呈交予氣體安全監督作記錄用途
This record will be submitted to the Gas Authority for recording purpose

「快速檢查」記錄分享 (4/4)



商用廚房氣體裝置「快速檢查」紀錄表 (石油氣瓶供氣)
Commercial Kitchen Gas Installation "Quick Check" Record Form (LPG Cylinder Supply)

客戶名稱 Name of customer: _____
地址 Address: _____
檢查日期 Date of checking: _____

A 部份 - 目測檢查 Part A - Visual Inspection	滿意 Satisfactory	需要改善 Improvement needed	不適用 N/A
石油氣瓶儲存室的完整性 Integrity of LPG cylinder storage chamber		✓	
外露硬喉管狀況 (是否有嚴重蝕蝕和損傷) Condition of exposed rigid pipework (any serious corrosion or damages)	✓		
石油氣瓶調節器狀況 (使用限期 Expiry date: 2023年) Condition of cylinder regulators		✓	
接駁軟喉狀況 (使用限期 Expiry date: _____) Condition of flexible tubing		✓	
B 部份 - 檢漏測試 Part B - Leak Tests			
外露硬喉接駁位和配件氣泡探漏測試 Bubble leak tests for exposed pipe joints and fittings	✓		
使用燃氣探測器為氣體裝置檢漏 Leak tests for gas installations using a gas detector	✗	✓	
(上述測試顯示在 4.1 kPa 下的供氣壓力下未有洩漏) (Leakage was not found at a supply pressure of _____ kPa in the above tests)	✓		
C 部份 - 功能測試 Part C - Functional Tests			
氣體用具運作狀況 Operation of gas appliances		✓	
煙火保險裝置運作狀況 Operation of flame failure devices		✓	
消防安全閘和氣閘運作狀況 Operation of fire safety and isolation valves	✓		
機動排氣系統運作狀況(開/關) Operation of mechanical ventilation system (On/Off)	✓		
機動排氣系統聯鎖裝置運作狀況 Operation of mechanical ventilation system interlock			✓
D 部份 - 氣體用具資料 Part D - Gas Appliance Information			
此廚房共有氣體用具 _____ 件，當中包括：There are _____ units of gas appliances in this kitchen, including:			
4 x 平爐/底爐 Boiling Table/ Stockpot	1 x 中式炒爐 Chinese Wok Range		
x 家用座爐 Domestic Hotplate	x 扒爐 Griddle Range		
x 中壓高壓爐 Medium Pressure Stove	x 焗爐 Oven		
x 焗豬/焗鴨爐 Pig / Duck Roaster	x 飯煲 Rice Cooker		
x 蒸櫃/爐 Steamer	x 熱水爐 Water Heater		
x 其他 Other (請註明 Please specify)			

* 刪去不適用者 Delete as appropriate

Rev. 8/2019

此紀錄將呈交予氣體安全監督作記錄用途
This record will be submitted to the Gas Authority for recording purpose

E 部份 - 改善建議 Part E - Recommended Improvement

✓ 建議更換 部份/全部 喉管。
Recommend replacing section(s)/all of the gas pipes.

✓ 建議更換 軟喉* 及 調節器*。
Recommend replacing the flexible tubing* and regulators*.

✓ 建議 更換/維修* 以下氣體用具。
Recommend repairing/replacing* the following gas appliances:

□ 建議安排一次全面的定期安全檢查，以作深入檢測。
Recommend arranging a comprehensive Regular Safety Inspection (RSI) for further examination.

□ 建議在營業時間結束時關上主供氣閘，並於顯眼位置展示相關的警告告示。
Recommend turning off the main gas supply valve before the close of business and displaying the related warning notices at prominent positions.

□ 應確保儲存於店舖內的石油氣瓶(包括空瓶)總容水量時刻不超過法例規限的 130 公升(約 50 公斤)。
Ensure the total nominal water capacity of LPG cylinders (including empty cylinders) in shop is always kept below the statutory limit of 130 litres (about 50kg).

□ 其他 Other: _____

✓ 檢查後發出危險氣體裝置通告 (編號: 409233)
A Dangerous Gas Installation (DGI) Notice was issued after checking (No. _____)

註：以上「快速檢查」旨在針對處所內氣體裝置及相關設施的基本運作和外露氣體喉管狀況進行初步檢測。食物業處所負責人應每 12 個月安排註冊氣體工程師承辦，為其氣體裝置及爐具進行一次更全面的定期安全檢查及維修保養，以確保氣體安全。
Note: The above "Quick Check" aims at providing a preliminary examination on the basic operation of the gas installations and the associated facilities and the condition of the exposed gas pipework in the concerned premise. To ensure gas safety, the responsible persons of licensed food premises should arrange a registered gas contractor to carry out a more comprehensive RSI, repair and maintenance of their gas installations and appliances once every 12 months.

* 刪去不適用者 Delete as appropriate

Rev. 8/2019

此紀錄將呈交予氣體安全監督作記錄用途
This record will be submitted to the Gas Authority for recording purpose

共有 3 間食肆
需要發出危險氣體裝置通告




商用廚房瓶裝石油氣裝置「快速檢查」 結果分析




商用廚房瓶裝石油氣裝置「快速檢查」結果



氣體裝置需作改善項目 (以項目分類)

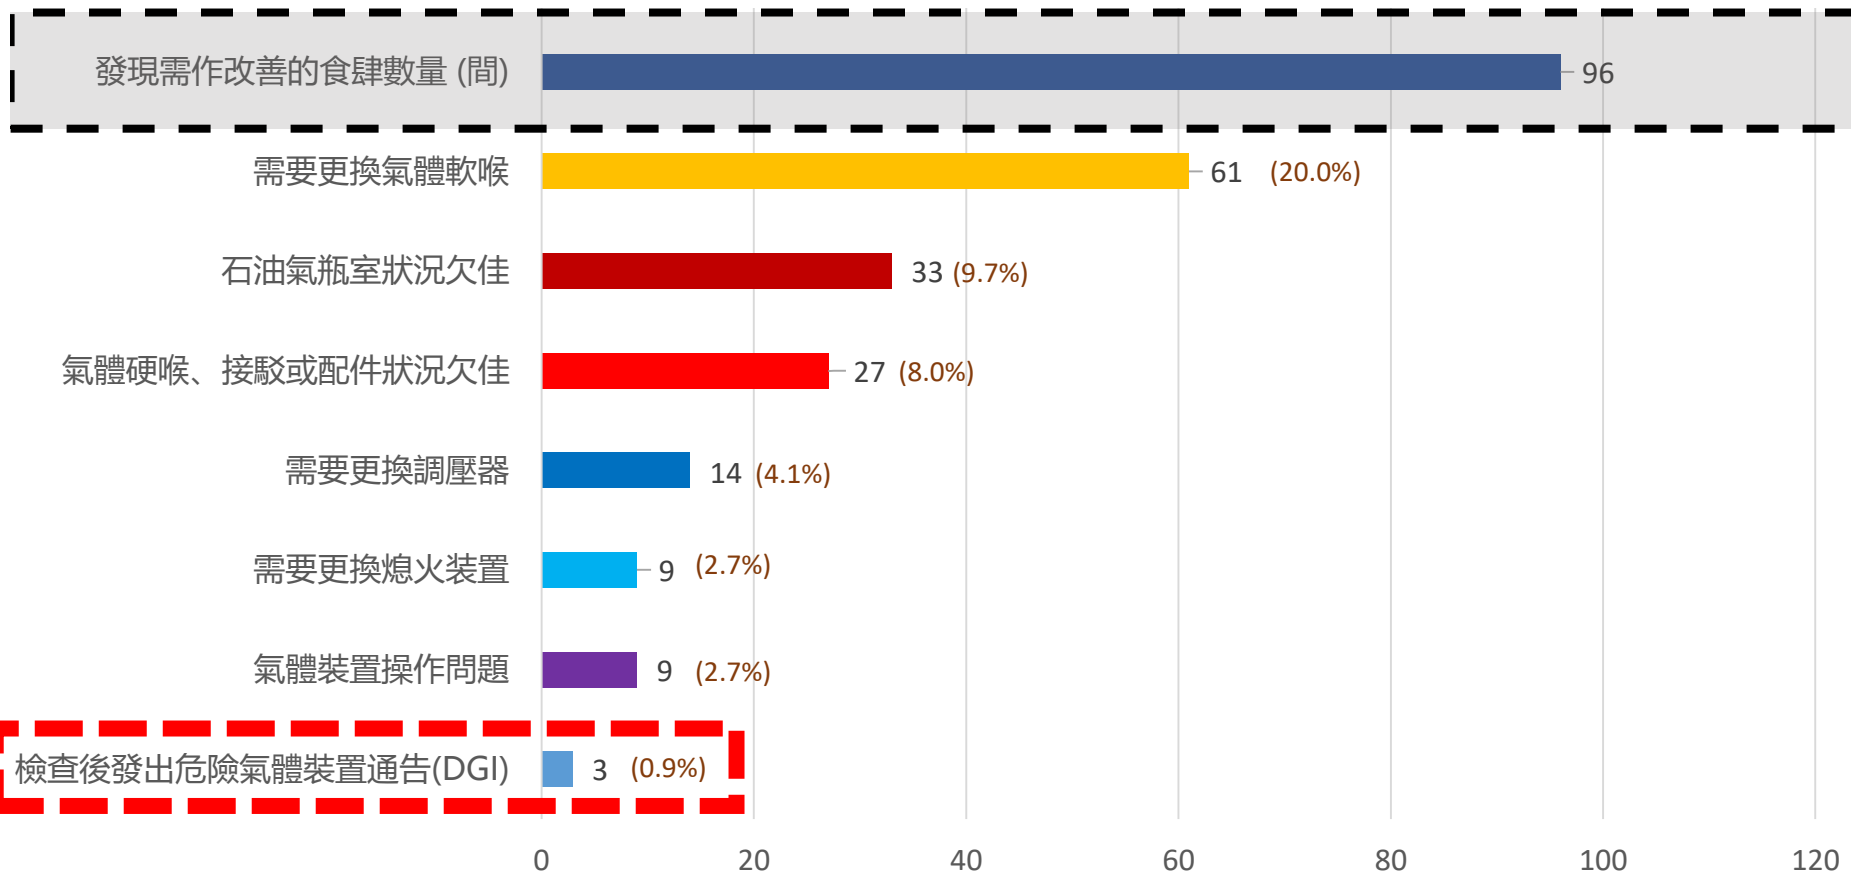

商用廚房瓶裝石油氣裝置「快速檢查」改善情況






在需要作出改善的食肆內，普遍發現需要「更換氣體軟喉」。這些氣體軟喉的狀況包括：

- (1) 使用過期氣體軟喉
- (2) 氣體軟喉上未有任何標記

更換氣體軟喉



商用廚房瓶裝石油氣裝置「快速檢查」改善情況

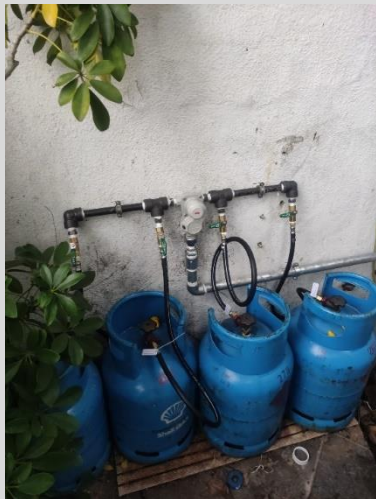


石油氣瓶室改善



氣體裝置改善



氣體硬喉、配件及軟喉狀況欠佳







氣體硬喉、接駁及配件改善 (曾發出危險氣體裝置通告個案)





氣體硬喉、接駁及配件改善 (曾發出危險氣體裝置通告個案)





總結





- 為商用氣體裝置每12個月進行一次 **「定期安全檢查」**。
- 所有氣體裝置工程或維修必須由註冊氣體工程承辦商及領有適當級別的氣體裝置技工**親自進行**。
- 進行維修或安全檢查之後，用戶應該**保留有關的工作紀錄**，以便安排下次的氣體安全檢查。
- 每次更換石油氣瓶時應**同時**檢查接駁氣體軟喉及調壓器狀況。



*Thank
You!*

